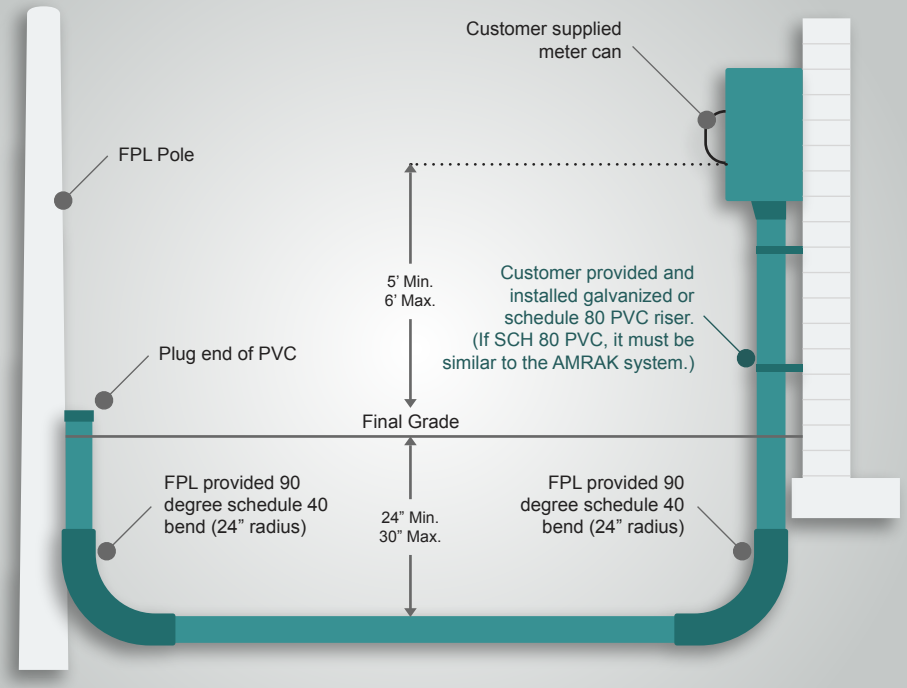
Customer supplied
meter can
FPL Pole
5' Min.
6' Max.
Customer provided and
installed galvanized or
schedule 80 PVC riser.
(If SCH 80 PVC, it must be
similar to the AMRAK system.)
Plug end of PVC
Final Grade
FPL provided 90
degree schedule 40
bend (24" radius)
24" Min.
30" Max.
FPL provided 90
degree schedule 40
bend (24" radius)